



REMOVAL PLAN

(NOT TO SCALE)

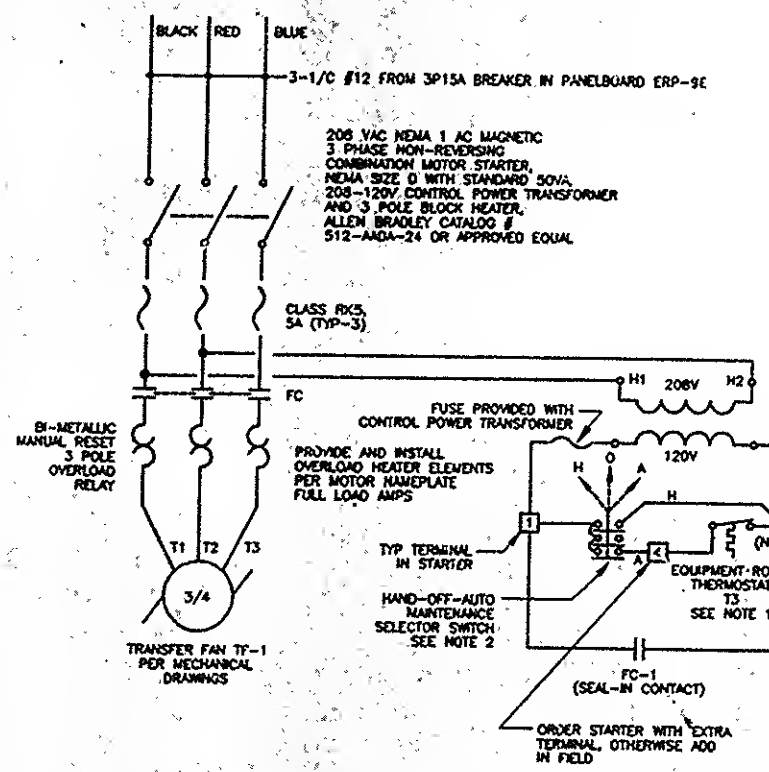

- NOTES:
1. 120 VAC RATED THERMOSTAT T3 CONTROL DEVICE IN THE RADIO EQUIPMENT ROOM PER MECHANICAL DRAWINGS. INSTALLED PER WIRING DIAGRAM ABOVE.
 2. STARTER SHALL CONTAIN ALLEN BRADLEY CATALOG # 800-T-22A OR APPROVED EQUAL 3 POSITION HAND-OFF-AUTO SELECTOR SWITCH WITH ENGRAVED NAMEPLATE MOUNTED EXTERNALLY ON STARTER ENCLOSURE AND WIRED PER NOTE 1.
 3. ALL MOTORIZED DAMPERS ARE COMPLETE WITH DISCONNECT SWITCH AND OVERLOAD RELAYS.

TRANSFER FAN WIRING DIAGRAM

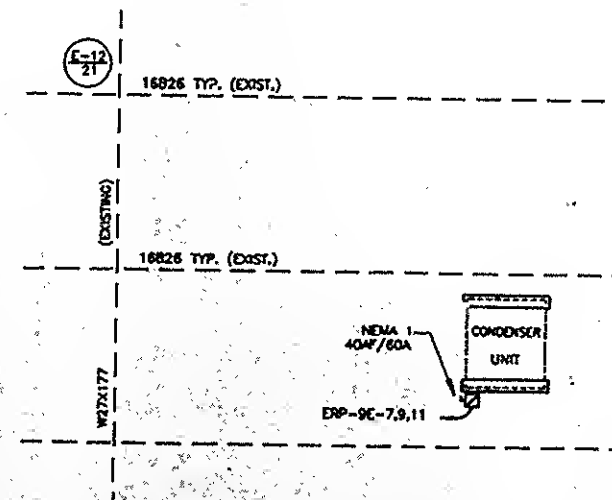

PARTIAL 9th FLOOR PLAN

SCALE IN FEET